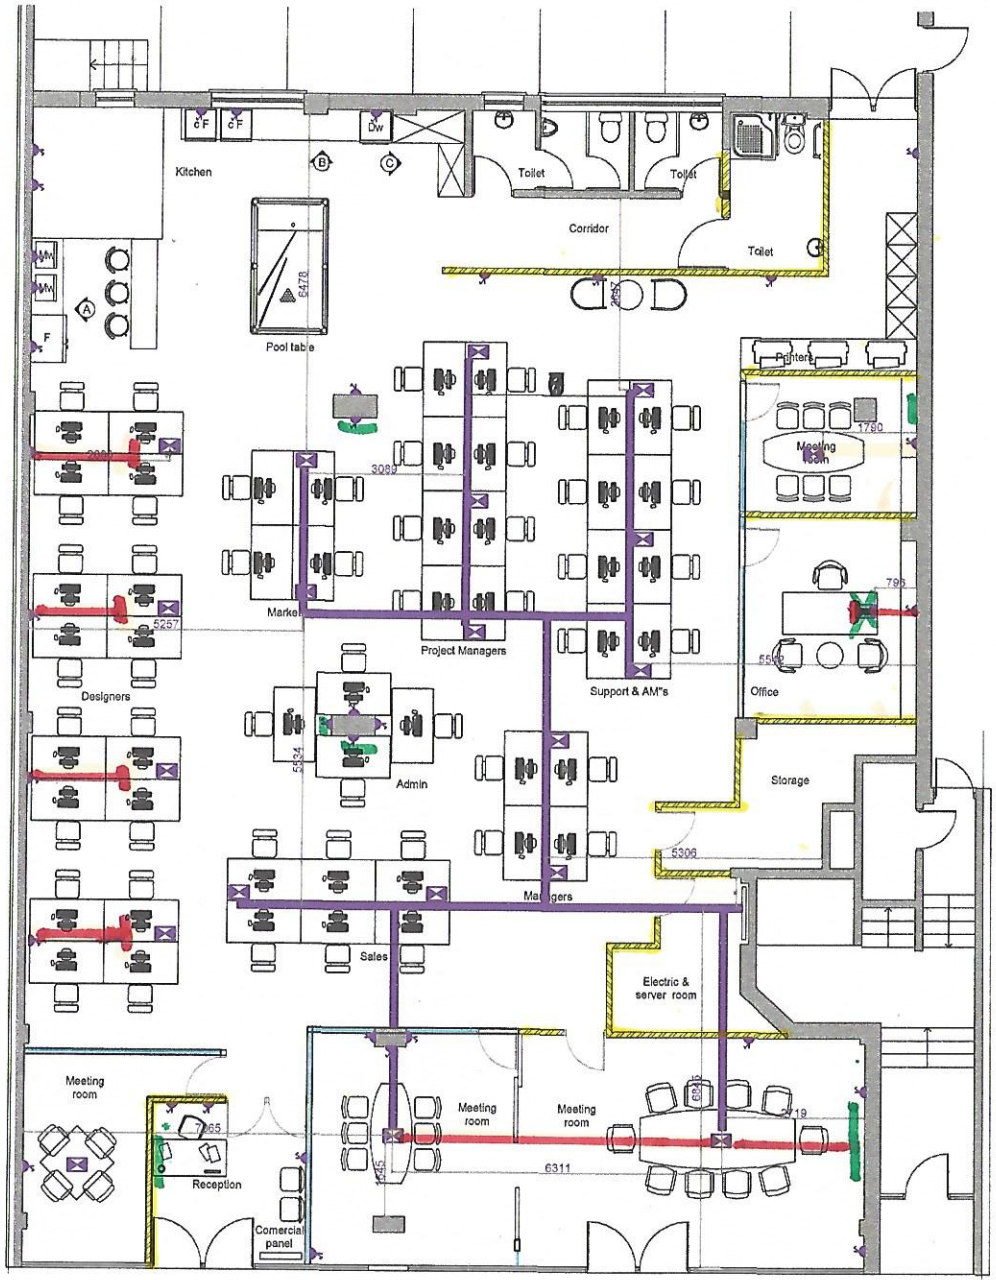

LOW LEVEL SERVICES KEY:

- NEW BADO TRUNKING
- NEW 3 COMPARTMENT EXISTING TRUNKING
- NEW 6 GANG POWER MODULE
- NEW 4 GANG POWER MODULE
- EXISTING DOUBLE SWITCHED SOCKET OUTLET
- RELOCATED DOUBLE SWITCHED SOCKET OUTL
- NEW DOUBLE SWITCHED SOCKET OUTLET
- EXISTING SINGLE SWITCHED SOCKET OUTLET
- RELOCATED SINGLE SWITCHED SOCKET OUTL
- NEW SINGLE SWITCHED SOCKET OUTLET
- EXISTING FLOOR BOX
- RELOCATED FLOOR BOX
- NEW FLOOR BOX
- REMOVED FLOOR BOX
- EXISTING CABLE GROMMET
- RELOCATED CABLE GROMMET
- NEW CABLE GROMMET
- EXISTING SPUR OUTLET
- RELOCATED SPUR OUTLET
- NEW SPUR OUTLET
- NEW TV OUTLET
- NEW COMMANDO SOCKET
- EXISTING RJ45 OUTLET
- RELOCATED RJ45 OUTLET
- NEW RJ45 OUTLET
- EXISTING CCTV CAMERA
- RELOCATED CCTV CAMERA
- NEW CCTV CAMERA
- EXISTING BREAK GLASS
- EXISTING EGRESS BUTTON
- EXISTING BREAK GLASS
- EXISTING EGRESS BUTTON
- EXISTING SWIPE ACCESS
- EXISTING KEYPAD ACCESS
- DIGI LOCK ACCESS
- RCD RESIDUAL CIRCUIT BREAKER

WTA POWER OR RJ45 OUTLET AT WORKTOP LEVEL
HA POWER OR RJ45 OUTLET AT HIGH LEVEL
LL POWER OR RJ45 OUTLET AT LOW LEVEL
1 INDICATES No. OF SWITCHES / OUTLETS
EX EXISTING FITTING
R RELOCATED FITTING
N NEW FITTING

ADDITIONAL KEY INFORMATION:

DESIGNERS AND DEVELOPERS TO HAVE 1 POWER AND 3 DATA OUTL
ALL OTHER WORKSTATIONS TO HAVE 1 POWER AND 1 DATA OUTLET
EACH WORKSTATION WILL NEED A CAT 6 OUTLET

○ Existing ○ Public Health
○ Partition Layout ○ High Level Ser
○ General Arrangement ○ Low Level Ser
○ Site Logistics ● Finishes
○ Siteworks ○ Furniture

Drawn: AE
Date: 04.08.2016
Scale: 1:50 @ A1

Client: SCHOOL WEBSITE

Project: 16-20 THE CAUSEWAY
TEDDINGTON
TW11 0HE

Drawing: LOW LEVEL SERVICES

No: 1567 – GF – LLS Rev

CCWS

WWW.CCWS.CO.UK
BIRCHIN COURT, 20 BIRCHIN LANE, LONDON, EC3V 9DU

Revision	Description	Date	By
-	———	00.00.00	--

Notes:
Layout Based on Architects Building Structure
Layout and All Dimensions are Subject to Confirmation survey on Site

DRAWING SIGN OFF
CCWS DESIGNER
CCWS PM
APPROVED BY CLIENT
DATE